



Sheet 90 of 112

THE PORT AUTHORITY  
OF NY & NJ

CONFORMED DRAWING  
08/2/98  
SIGNED AND SEALED  
COPY IS KEPT ON FILE

ORIGINAL SIGNED & SEALED BY  
N.Y. P.E. (OR R.A.)

Joseph R. Loring  
& Associates, Inc.  
consulting engineers

One Pennsylvania Plaza  
New York, New York 10008-0045  
Tel: (212) 363-7400, Fax: (212) 363-7363

THE OFFICE OF  
DAVID  
BLICK  
LEIBOWITZ  
P.C.  
ARCHITECTS  
110 WEST 47TH STREET  
NEW YORK, NY 10036  
TEL: (212) 693-1000 FAX: (212) 693-1001

LESLIE E. ROBERTSON  
ASSOCIATES, P.L.L.P.  
CONSULTING STRUCTURAL ENGINEERS  
20 EAST 47TH STREET  
NEW YORK, NY 10017  
TEL: (212) 693-1000 FAX: (212) 693-1001

No. Date Revision Approved  
Engineering Department  
Design Divisions

The  
World  
Trade  
Center

STANDBY POWER  
5 WORLD TRADE CENTER

FIRE PROTECTION


5 WTC PART PLAN  
FUEL OIL TANK ROOM

This drawing subject to conditions in contract.  
All inventions, ideas, designs and methods  
herein are reserved to Port Authority and  
may not be used without its written consent.

VP M.A.R. VP  
Designed by Drawn by Check by

Date 11/17/97 Scale AS S-000

Contract Number WTC-945.071 Drawing Number FFP-01

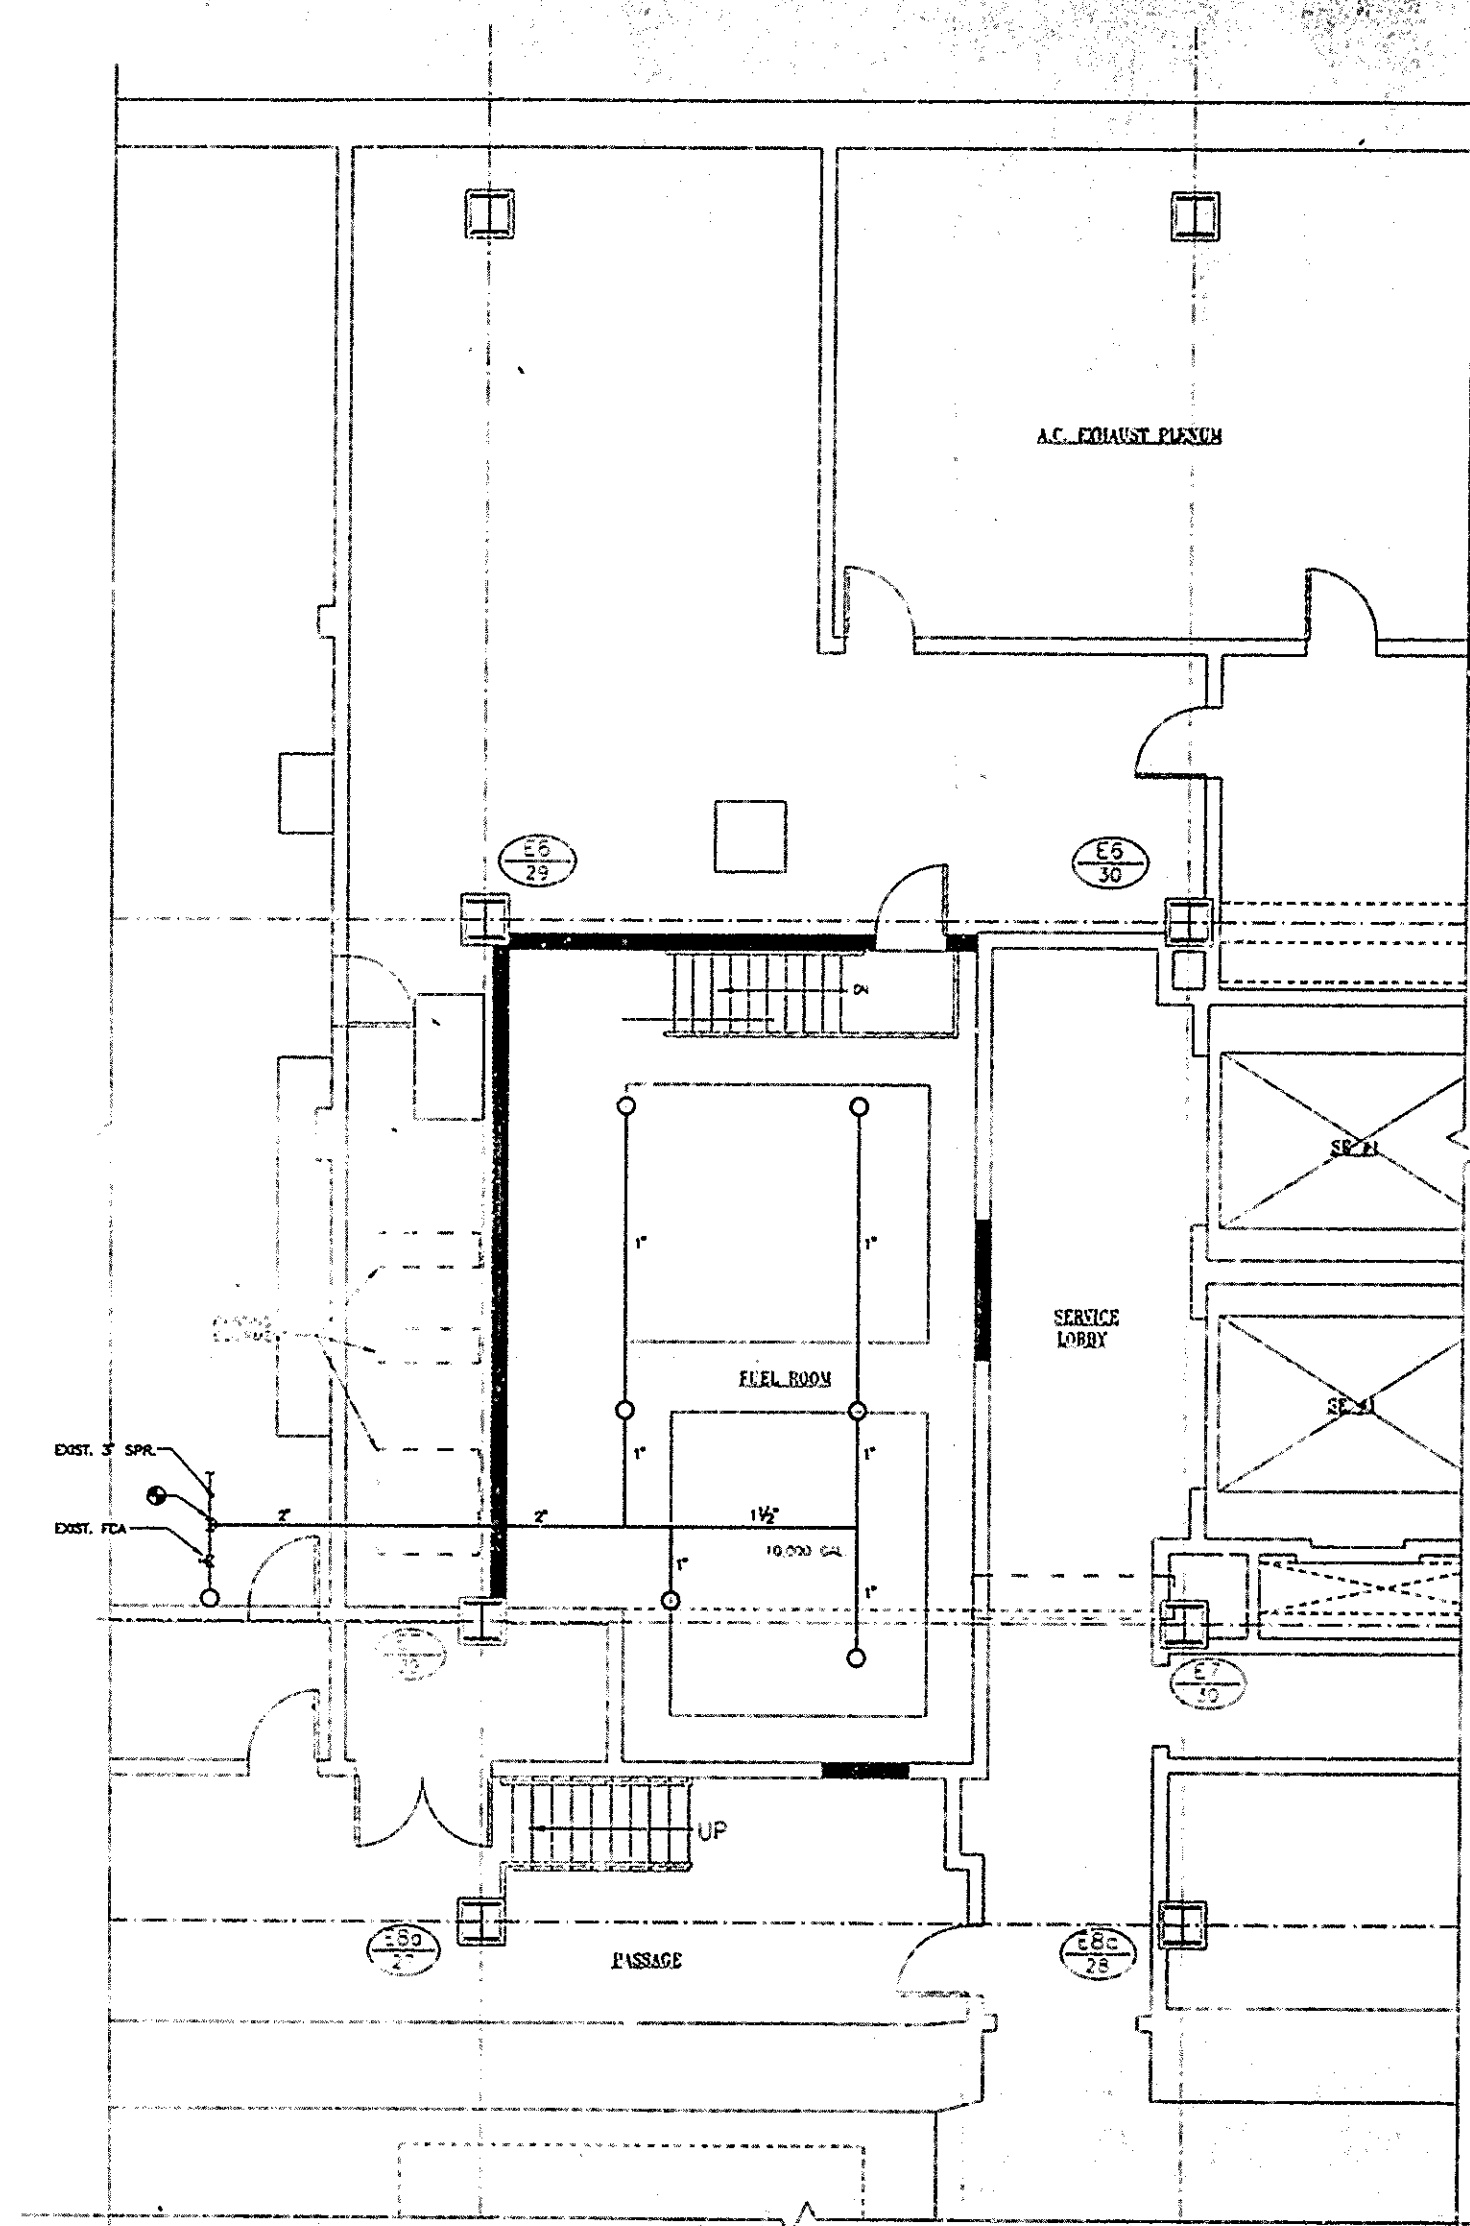

NOTE:  
LOCATE SPRINKLER DETECTORS MAX. OF 1' &  
MAX. OF 6" BELOW BOTTOM OF 12" STEEL BEAMS

5 WTC PART PLAN B2 LEVEL  
FUEL OIL TANK ROOM

